

**Intertek****ETL SEMKO****NVLAP<sup>®</sup>**For The Scope of Accreditation  
Under NVLAP Lab Code 100402-0.

Order No. 3053682

Date of Revision: May 18, 2004  
Original Issue Date: January 22, 2004**REPORT NO. 3053682-002A****IMPACT SOUND TRANSMISSION TEST  
AND CLASSIFICATION OF CERAMIC TILE  
OVER CERAZORB UNDERLAYMENT  
ON A FLOOR/CEILING ASSEMBLY****RENDERED TO****SOUND SEAL  
50 H. P. ALMGREN DRIVE  
AGAWAM, MA 01001****INTRODUCTION**

This report gives the results of an Impact Sound Transmission test and determination of the Impact Insulation Class on ceramic tile over Cerazorb underlayment. The underlayment was selected and supplied by the client and received at the laboratories on January 9, 2004. The sample appeared to be in new, unused condition upon arrival.

**AUTHORIZATION**

Signed Quote No. 14115099 and Purchase Order No. 7998 from Sound Seal.

**TEST METHOD**

The specimen was tested in accordance with the American Society for Testing and Materials designation ASTM E492-90 (Re-approved 1996), "Standard Test Method for Laboratory Measurement of Impact Sound Transmission through Floor-Ceiling Assemblies Using the Tapping Machine". It was classified in accordance with ASTM E989-89 (Re-approved 1999), entitled, "Standard Classification for Determination of Impact Insulation Class (IIC)".

**An Independent organization testing for safety, performance, and certification.**

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to copy or distribute this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. Measurement uncertainty budgets have been determined for applicable test methods and are available upon request.

**GENERAL**

The method is designed to measure the impact sound transmission performance of a floor-ceiling assembly, in a controlled laboratory environment. A standard tapping machine (B & K Type 3204) was placed at four positions on a test floor that forms the horizontal separation between two rooms, one directly above the other. The data obtained was normalized to a reference room absorption of 10 square meters in accordance with the test method.

The standard also prescribes a single-figure classification rating called "Impact Insulation Class, IIC" which can be used by architects, builders and code authorities for acoustical design purposes in building construction.

The IIC is obtained by matching a standard reference contour to the plotted normalized one-third octave band sound pressure levels at each test frequency. The greater the IIC rating, the lower the impact sound transmission through the floor-ceiling assembly.

**DESCRIPTION OF THE FLOOR/CEILING ASSEMBLY**

The test floor is a 100 sq. ft. opening that forms the horizontal separation of the two rooms, one directly above the other. The structural members are open webbed wood floor trusses, 16 inches deep installed 24 inches on center. The sub flooring is 5/8 inch thick tongue and groove plywood. The bridging is a continuous 2 x 4 nailed to the bottom chord and the sides of the diagonals with 2 inch long nails. Single leaf RC-1 resilient channels (2 1/2 inch x 1/2 inch) were spaced 16 inches on center and attached to the bottom chord by screws. The insulation is 5 1/2 inches cellulose with a density of 1.6 pcf. The ceiling is gypsum board, 5/8 inches thick, with the long edges located between the joists perpendicular to the resilient channels. Short edges are staggered by 4 ft. Sheets are fastened to the resilient channels by means of 1 1/2 inch screws located 1/2 inch away from the edge and 3 inches from the long edges; screws are spaced 6 inches on center. Joints are taped and finished with two layers of compound.

The topping over the tongue and groove plywood sub-floor is 1 1/2 inches of light grade concrete.

Report No. 3053682-002A

Page 3 of 5

**DESCRIPTION OF TEST SPECIMEN**

**Cerazorb over wood construction**

Specimen Description: Ceramic tile floor covering over Impacta "Cerazorb" underlayment installed over a wood construction.

The test specimen was a floor-ceiling assembly consisting of the following:

- 1 layer of 12" x 12" x 1/4" thick ceramic tiles
- 1 layer of Latex Modified Thin Set mortar
- 1 layer of 5mm (.1875") thick Cerazorb 5.5# beaded foam composite underlayment.

Specimen Size: 8' x 8'

The description of the test specimen was supplied by the client.

**RESULTS OF TEST**

The data obtained in the room below the panel normalized to  $A_0 = 10$  square meters, is as follows:

<u>1/3 Octave Band Center Frequency Hz</u>	<u>1/3 Octave Band Sound Pressure Level dB re 0.0002 Microbar</u>
100	63
125	62
160	63
200	63
250	63
315	64
400	64
500	61
630	58
800	56
1000	52
1250	48
1600	44
2000	44
2500	41
3150	36
Impact Insulation Class (IIC)	52

**PRECISION**

The 95% uncertainty level for each tapping machine location is less than 3 dB for the 1/3 octave bands centered in the range from 100 to 400 Hz and less than 2.5 dB for the bands centered in the range from 500 to 3150 Hz.

For the floor/ceiling construction, the 95% uncertainty limits ( $\Delta L_n$ ) for the normalized sound pressure levels were determined to be less than 2 dB for the 1/3 octave bands centered in the range from 100 to 3500.

Report No. 3053682-002A

Page 5 of 5

**REMARKS**

1. Curing Period: 5 days
2. Ambient Temperature 70°F
3. Relative Humidity: 17%

**CONCLUSION**

The test method employed for this test has no pass-fail criteria, therefore, the evaluation of the test results is left to the discretion of the client.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government.


Date of Test: January 20, 2004

Report Approved By:

Report Reviewed By:



James R. Kline  
Associate Engineer  
Acoustical Testing

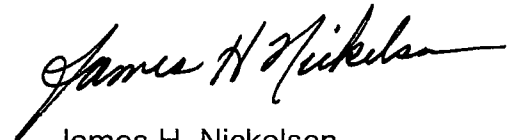

James H. Nickelsen  
Senior Project Engineer  
Acoustical Testing