



FIELD TEST REPORT IMPACT SOUND TRANSMISSION

Report Date: February 23, 2005 (revised 2/4/08)

Client:	Forrest Sound Products	Test Number:	04-94-1
	2415 82 Ave. N.E.	Test Date:	12/7/04
	Medina, WA 98039	Tested By:	Jerry G. Lilly

Test Specimen: Ceramic Tile over Cera-Zorb on 7.5-inch concrete slab (no ceiling below)

Installation: First & Clay Condominiums, Unit 1107 Master Bedroom
Seattle, Washington

Introduction

This report presents the results of a field test of impact sound transmission for the referenced test specimen. The test method generally conforms to the procedure described in ASTM E 1007-97, Standard Test Method for Field Measurement of Tapping Machine Impact Sound Transmission Through Floor-Ceiling Assemblies and Associated Support Structures. The field IIC (FIIC) rating was determined using the procedure described in ASTM E 989-89 (1999).

Test Configuration and Environment

The test specimen was located near the center of the master bedroom of Unit # 1107 in the First & Clay condominium project (currently under construction) in Seattle, WA. The test specimen consisted of a 3-ft. by 4-ft sample of 3/16-inch thick Cera-Zorb underlayment, to which 1/4-inch thick ceramic tiles were installed with thin-set mortar. The test specimen was installed on a sheet of construction paper to facilitate sliding the sample into and out of the test position. The structural floor consisted of a 7.5-inch thick post-tensioned concrete slab, which was poured several months prior to the test. The master bedroom of Unit #1007 served as the receiving room for this test. The two bedrooms stacked vertically in the building, and the volume of each room was 1407 cubic feet. The receiving room was not yet carpeted, and there were no sound absorbing materials in the receiving room. The floor and the ceiling consisted of exposed concrete, and the walls were painted gypsum board. Reverberation measurements in the receiving room were conducted in accordance with ASTM E 2235-04.



Description of the Test Specimen

The test specimen consisted of ¼-inch thick ceramic tiles secured to the 3/16-inch thick Cera-Zorb underlayment with thin-set mortar. A total of 12 ceramic tiles were used to fabricate the 3-ft. wide by 4-ft. long test specimen. The test sample was installed on construction paper to facilitate moving the sample into and out of its test position. A second sample was also tested, except that the underlayment material for that sample was ½-inch thick cork. Both test specimens were tested with the same tapping machine in the same location. The thin-set mortar was allowed to cure for 36 hours prior to the test, and the grout was allowed to cure for 12 hours prior to the test. Both test samples had the same curing time.

Test Instrumentation

Tapping Machine: Norsonics Type 211, Serial No. 20487
Signal Analyzer: Bruel & Kjaer model 2144, Serial No. 1673608
Calibrator: Bruel & Kjaer model 4230, Serial No. 1025975
Noise Generator: Bruel & Kjaer model 4224, Serial No. 1042285

Test Results

The measured test results are presented on pages 3 and 4 in tabular form and on pages 5 and 6 in graphical form. Flanking sound transmission between the source and receive rooms appeared to be insignificant. **The FIIC rating for the Cera-Zorb underlayment is 59. The FIIC rating for the ½-inch cork underlayment is 60.**

Certification

I hereby certify that the test results presented in this report were obtained in conformance with ASTM E 1007-97 (except for the limited physical size of the test specimen and the volume of the receive room), and they accurately reflect the acoustical performance of the specimen that was tested. No other modifications were made to the test specimen or setup to reduce flanking.

Respectfully submitted,

A handwritten signature in black ink that reads "Jerry G. Lilly".

Jerry G. Lilly, P.E.
President



Ceramic Tile on Cera-Zorb MBR 1007					Ceramic Tile on CeraSorb 7.5-inch Concrete Slab, No Ceiling					Sample Size:	12.0 sq.ft.	Test Date:	12/7/04
Impact Sound Pressure Levels					Ambient Corrected	Energy	Reverb.	Absorption	Normal.	59	Total	Max.	
Frequency (Hz)	Pos. 1	Pos. 2	Pos. 3	Pos. 4	Ambient	Avg. SPL	Time (sec)	(sabins)	ISPL* (dB)	IIC Contour	Def.	Def.	
20	52.8	52.7	50.3	51.9	45.6	50.9			50.9				
25	44.1	42.1	43.1	43.5	42.4	41.2			41.2				
31	49.2	48.6	49.7	46.1	40.2	47.9			47.9				
40	48.8	49.9	50.0	49.6	40.1	49.1			49.1				
50	45.0	44.5	46.4	45.1	34.1	45.0			45.0				
63	50.8	51.8	50.7	50.8	37.2	50.9			50.9				
80	46.9	47.8	48.5	47.0	39.5	46.9			46.9				
100	48.9	48.9	49.0	48.7	37.9	48.5	0.57	122	49.1	53	0	*	
125	56.5	56.6	56.0	56.7	38.9	56.4	0.66	106	56.3	53	3		
160	57.7	57.9	56.9	58.4	34.4	57.7	0.77	91	57.0	53	4		
200	59.5	58.9	57.8	58.6	38.0	58.7	0.79	88	57.8	53	5		
250	61.3	61.2	59.0	61.3	37.4	60.8	0.60	116	61.1	53	8		
315	60.2	59.9	57.2	59.1	29.2	59.2	0.50	139	60.3	53	7	#	
400	52.5	51.6	49.7	51.3	25.1	51.4	0.48	145	52.7	52	1	#	
500	46.7	46.0	50.5	49.2	24.7	48.4	0.52	134	49.4	51	0	#	
630	45.7	40.9	48.9	47.6	24.4	46.6	0.63	111	46.7	50	0		
800	43.9	40.4	46.7	46.2	26.7	44.9	0.62	112	45.0	49	0		
1000	40.4	37.1	44.0	43.7	27.4	41.9	0.71	98	41.5	48	0		
1250	33.7	33.2	39.7	39.3	23.8	37.2	0.79	88	36.4	45	0		
1600	33.1	31.4	41.1	34.6	21.9	36.6	0.75	93	36.0	42	0		
2000	31.8	31.4	39.8	31.0	21.3	35.2	0.70	100	34.8	39	0		
2500	29.7	29.6	35.2	29.2	21.0	31.4	0.67	104	31.2	36	0		
3150	25.9	24.2	27.6	26.9	20.0	25.1	0.68	103	24.9	33	0		
4000	20.7	20.7	24.5	22.3	18.8	20.3	0.67	104	20.2				
5000	18.0	17.6	21.7	20.0	17.7	17.7	0.67	104	17.5				
dBL	85.2	80.9	81.6	80.2	80.0	80.4							
dBA	58.3	57.7	57.4	58.2	36.6	57.9							

I certify that this test was conducted in accordance with ASTM E 1007-97

The FIIC rating for this assembly is: 59

Jerry G. Lilly, P.E.
 President

Date

* Room volume is too small for accurate data in these bands
 # Room absorption exceeds value recommended by ASTM E 1007-97

CAUTION: TEST RESULTS MAY NOT BE APPLICABLE FOR PRODUCT GLUED TO FLOOR SLAB.



Ceramic Tile on 1/2" Cork MBR 1007					Ceramic Tile over 1/2-inch Cork 7.5-inch Concrete Slab, No Ceiling					Sample Size:	12.0 sq.ft.	Test Date:	12/7/04		
										Room Volume:	1406 cu.ft.	Temperature:	60 deg. F	Total Def.	Max. Def.
										Ambient Corrected Energy Avg. SPL	Reverb. Time (sec)	Absorption (sabins)	Normal. ISPL* (dB) Contour	IIC	60
Frequency (Hz)	Pos. 1	Pos. 2	Pos. 3	Pos. 4	Ambient	Ambient Corrected Energy Avg. SPL	Reverb. Time (sec)	Absorption (sabins)	Normal. ISPL* (dB) Contour	IIC	60	Total Def.	Max. Def.		
20	52.5	51.2	51.3	49.8	45.0	50.1			50.1						
25	43.9	43.3	42.1	42.6	40.7	41.0			41.0						
31	48.2	46.9	46.4	46.9	42.1	45.5			45.5						
40	48.9	50.7	51.0	49.8	44.5	48.8			48.8						
50	44.9	44.2	46.0	47.0	37.1	45.0			45.0						
63	50.1	49.6	48.9	48.8	38.0	49.0			49.0						
80	47.2	48.2	49.3	46.6	39.4	47.3			47.3						
100	49.0	49.5	47.8	47.8	39.4	48.0	0.57	122	48.6	52	0	*			
125	55.1	56.9	56.6	56.7	39.2	56.3	0.66	106	56.2	52	4				
160	56.7	55.9	55.5	57.1	36.7	56.3	0.77	91	55.5	52	4				
200	56.4	56.9	55.6	56.9	39.6	56.4	0.79	88	55.5	52	4				
250	56.9	57.5	57.0	56.7	38.9	57.0	0.60	116	57.3	52	5				
315	56.6	58.0	55.7	55.8	30.1	56.6	0.50	139	57.7	52	6	#			
400	55.2	54.5	51.3	52.5	25.4	53.6	0.48	145	54.9	51	4	#			
500	52.9	50.9	48.8	49.7	24.9	50.8	0.52	134	51.8	50	2	#			
630	49.5	48.2	45.8	47.9	25.1	48.0	0.63	111	48.1	49	0				
800	48.4	47.2	44.1	44.8	26.8	46.4	0.62	112	46.6	48	0				
1000	45.7	44.1	40.9	42.9	27.2	43.6	0.71	98	43.2	47	0				
1250	41.2	40.2	38.3	38.3	23.2	39.6	0.79	88	38.7	44	0				
1600	40.1	33.2	37.4	34.2	20.5	37.0	0.75	93	36.3	41	0				
2000	36.1	31.0	34.5	32.2	18.7	33.7	0.70	100	33.4	38	0				
2500	30.5	30.3	29.3	29.0	18.1	29.5	0.67	104	29.4	35	0				
3150	24.7	26.4	23.1	23.6	17.2	23.8	0.68	103	23.5	32	0				
4000	21.9	18.7	19.3	19.6	15.2	18.0	0.67	104	17.9						
5000	17.5	16.5	16.9	17.7	13.7	15.2	0.67	104	15.0						
dBL	73.3	74.5	75.5	76.9	75.3	73.2									
dBA	57.9	57.6	55.7	56.3	36.8	56.9									

I certify that this test was conducted in accordance with ASTM E 1007-97

The FIIC rating for this assembly is: 60

Jerry G. Lilly, P.E.
 President


Date

* Room volume is too small for accurate data in these bands
 # Room absorption exceeds value recommended by ASTM E 1007-97

CAUTION: TEST RESULTS MAY NOT BE APPLICABLE FOR PRODUCT GLUED TO FLOOR SLAB.



**Ceramic Tile on Cera-Zorb
 Impact Noise in MBR 1007
 (Field IIC-59*)**

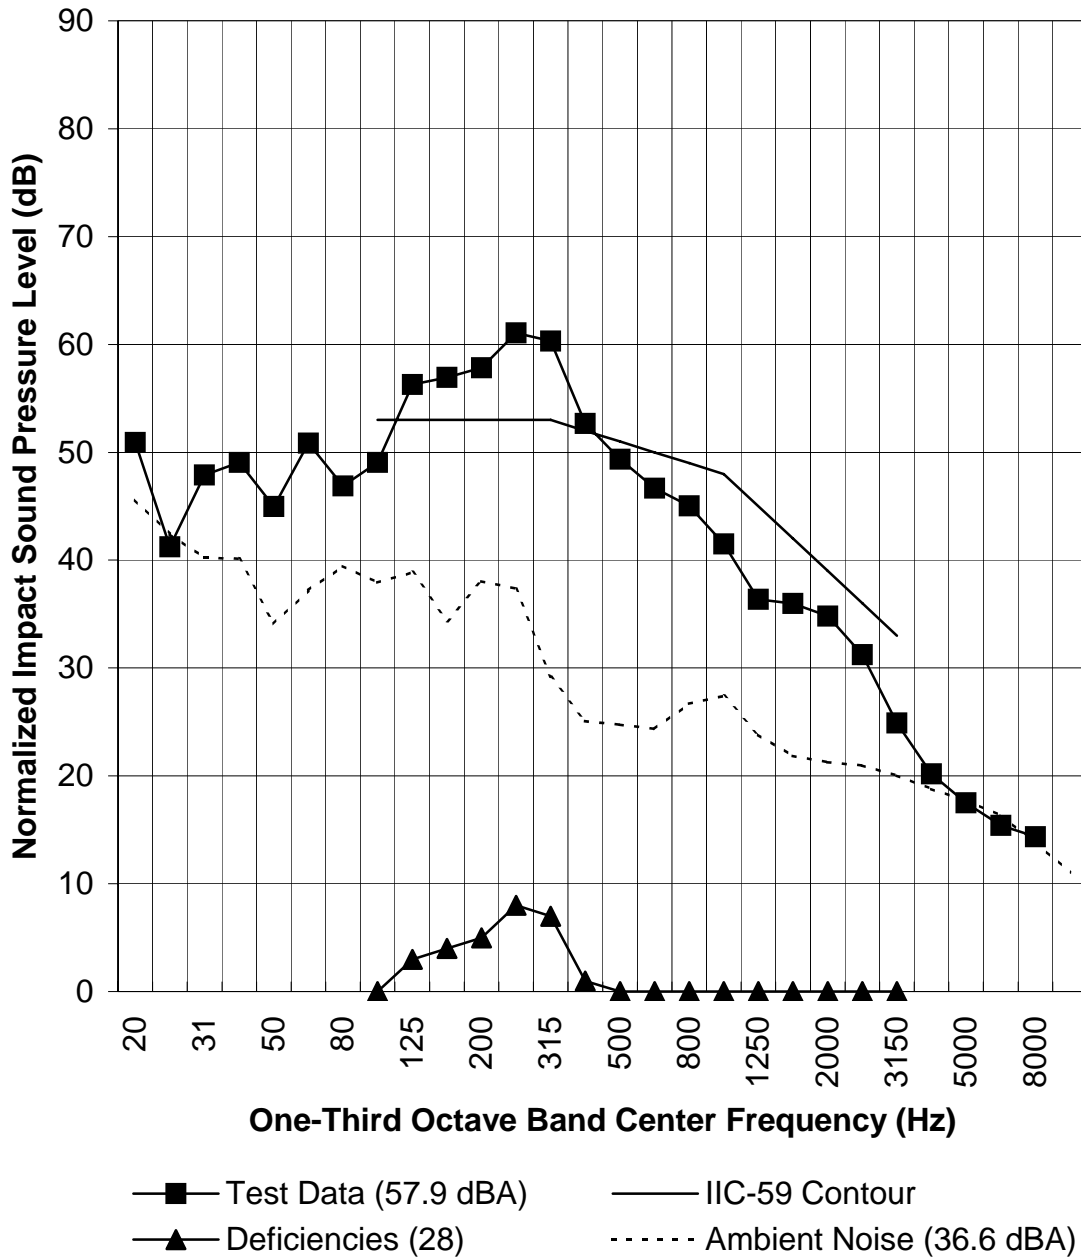



**Ceramic Tile on 1/2" Cork
 Impact Noise in MBR 1007
 (Field IIC-60*)**

